

- ①
- ②
- ③
- ④

FLUID IN  
 FLUID OUT  
 CONDENSATE DRAIN x 2 (1 1/2")  
 SUGGESTED AREA FOR ELECTRICAL CONNECTION TO BE FIELD INSTALLED BY OTHERS

DISCLAIMER: DO NOT COVER UNIT NAMEPLATE WHILE MAKING THIS CONNECTION


**REMARKS**

1. FILTERS ARE AS FOLLOWS  
 MERV8 PREFILTERS, 12"X24"X2" (QTY:2) MERV8 PREFILTERS, 24"X24"X2" (QTY:2) MERV13 BAG FILTERS, 12"X24"X2" (QTY:2) MERV13 BAG FILTERS, 24"X24"X15" (QTY: 2) MERV8 EXHAUST FILTERS, 12"X24"X2" (QTY: 2) MERV8 EXHAUST FILTERS, 24"X24"X2" (QTY: 2)
2. † MINIMUM CLEARANCE FOR SERVICE IS NOT ENOUGH FOR HEAT WHEEL REPLACEMENT

CAPACITY (TONS)	WATER PIPE CONNECTIONS*	CONNECTION TYPES
5-10	1.25" (10 GPM - 20 GPM)	FEMALE THREADS
12-15	1.5" (24 GPM - 30 GPM)	FEMALE THREADS
18-20	2" (36 GPM - 40 GPM)	GROOVED**

\* Based On 2 GPM/Ton

\*\* Mechanical grooved coupling supplied by manufacturer

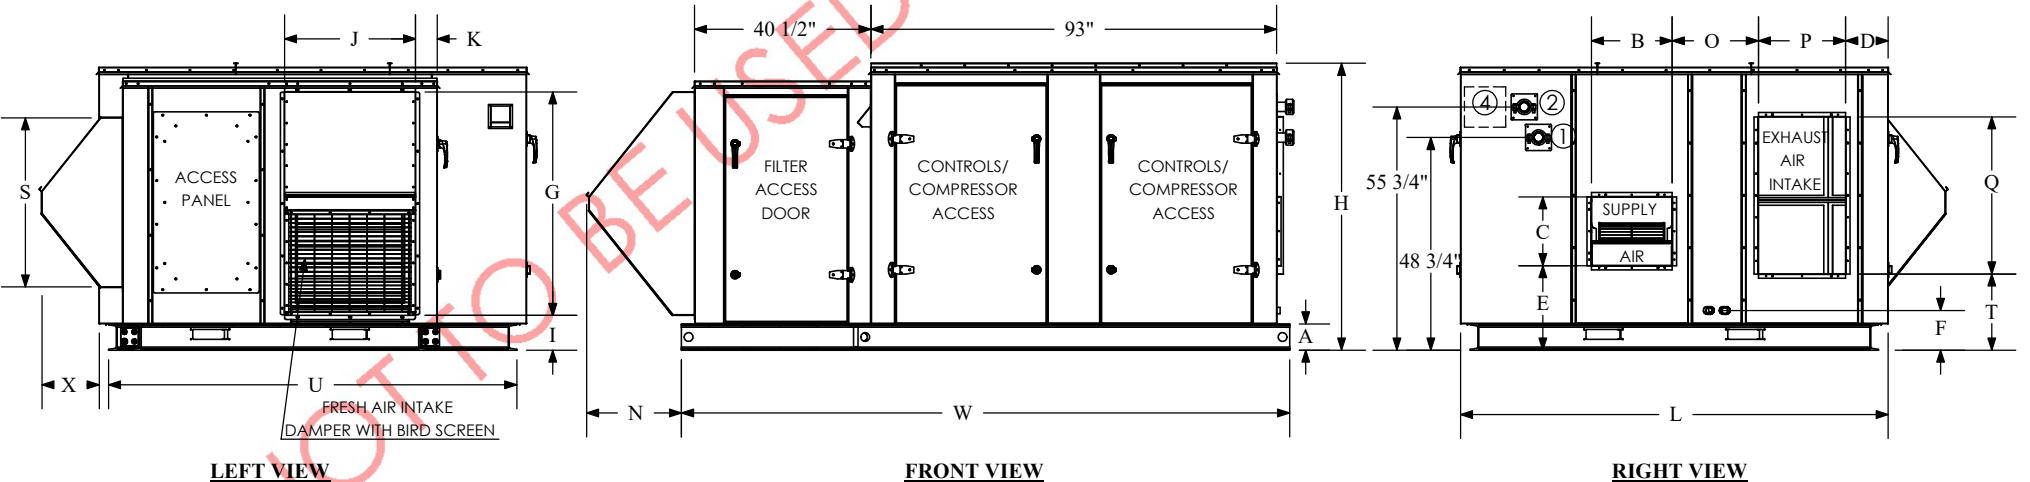

PHYSICAL DATA (IN)																							
H	W	L	A	B	C	D	E	F	G	I	J	K	M	N	O	P	Q	R	S	T	U	V	X
65 3/4"	139 3/8"	98"	6"	18 1/2"	15 3/4"	9 3/4"	19 3/8"	9 1/8"	51 1/4"	8"	30"	5"	5 1/2"	21 3/4"	19 3/4"	20"	36"	73 1/8"	38 3/4"	17 1/2"	93 5/8"	21 3/4"	13 1/8"

NAME:	DATE (MM/DD/YYYY):	TITLE: VARIPAK WITH ENERGY RECOVERY WHEEL SIZE 3 (OUTDOOR)
DRAWN BY: AD	11/3/2021	HORIZONTAL INTAKE & SUPPLY
CHECKED BY: FS	11/3/2021	HORIZONTAL EXHAUST IN
		HORIZONTAL EXHAUST DISCHARGE
		UNIT MODEL: VPWR3XX
<small>THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CCG GROUP. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CCG GROUP IS PROHIBITED.</small>		SCALE: NTS
<small>PROPRIETARY AND CONFIDENTIAL</small>		SHEET 1 OF 1