


- ① FLUID IN
 - ② FLUID OUT
 - ③ CONDENSATE DRAIN x 1 (1 1/2")
 - ④ SUGGESTED AREA FOR ELECTRICAL CONNECTION TO BE FIELD INSTALLED BY OTHERS
- DISCLAIMER: DO NOT COVER UNIT NAMEPLATE WHILE MAKING THIS CONNECTION*


REMARKS

1. FILTERS ARE AS FOLLOWS
 MERV8 PREFILTERS, 24"X24"X2" (QTY:2)
 MERV13 BAG FILTERS, 24"X24"X15" (QTY: 2)
 MERV8 EXHAUST FILTERS, 24"X24"X2" (QTY: 2)
2. † MINIMUM SERVICE CLEARANCE IS NOT ENOUGH FOR HEAT WHEEL REPLACEMENT
3. EXHAUST FANS AND FILTER BOX SHIPS WITH SUPPORTS NOT REQUIRED FOR INSTALLATION

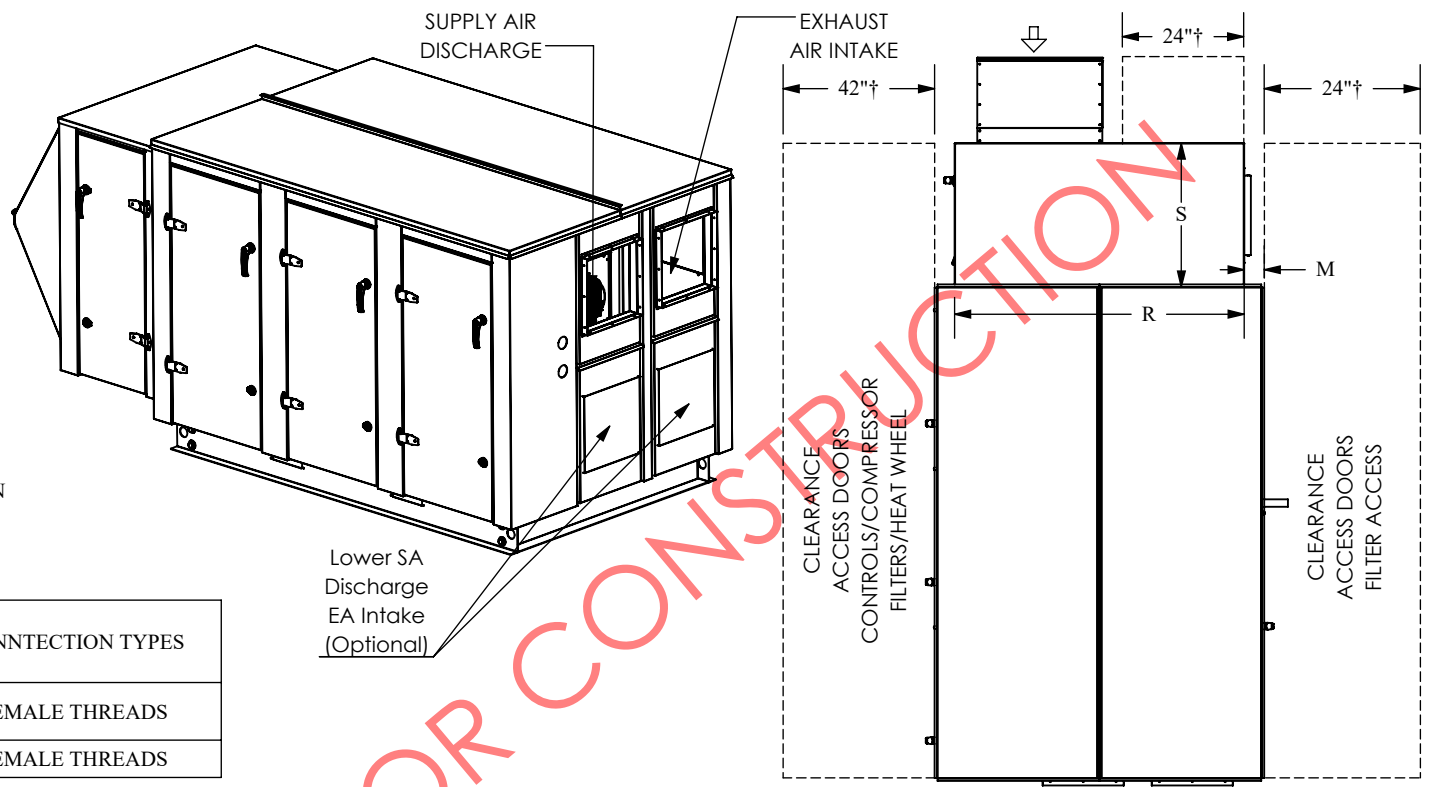

CAPACITY (TONS)	WATER PIPE CONNECTIONS*	CONNECTION TYPES
5-10	1.25" (10 GPM - 20 GPM)	FEMALE THREADS
12	1.5" (24 GPM)	FEMALE THREADS

* Based On 2 GPM/Ton

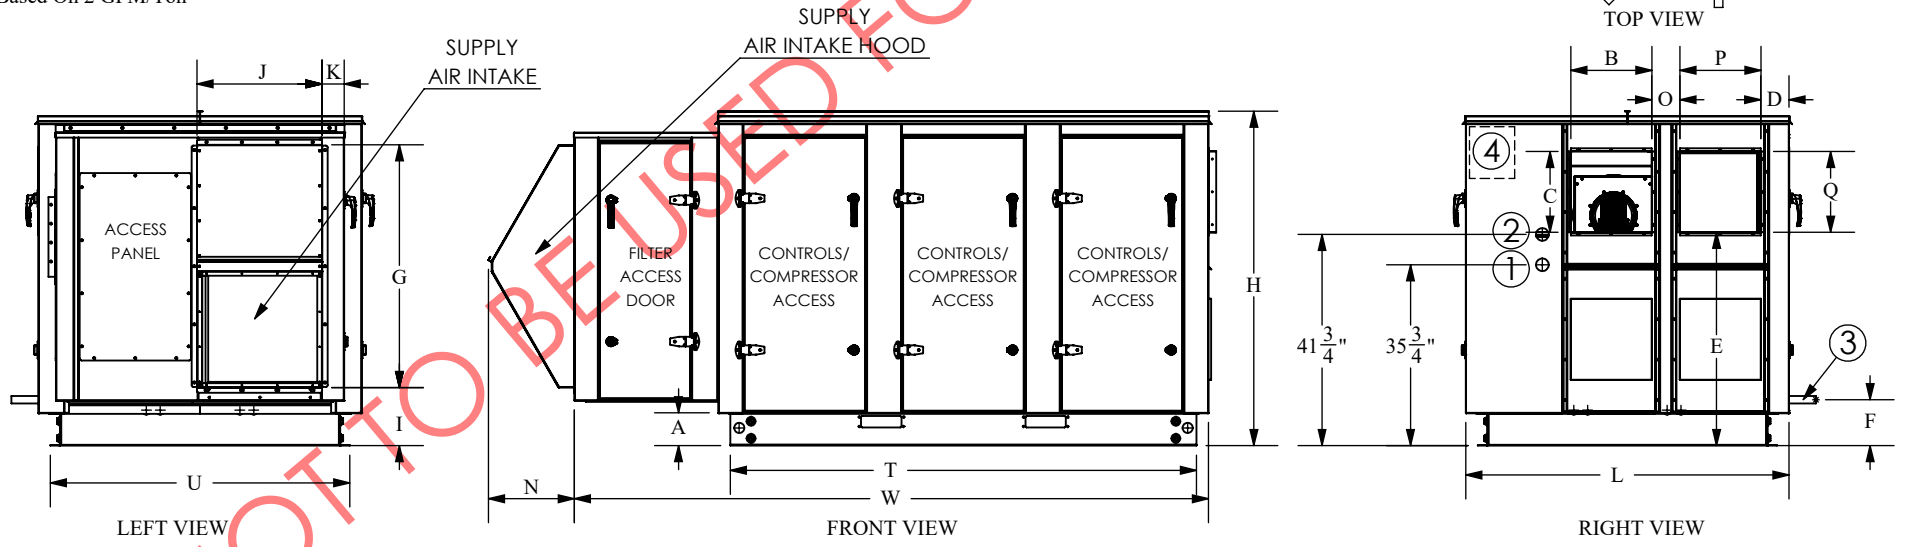

PHYSICAL DATA (IN)																					
H	W	L	A	B	C	D	E	F	G	I	J	K	M	N	O	P	Q	R	S	T	U
66 1/8"	125 1/2"	64"	6 1/2"	16"	16"	5 5/8"	42 1/4"	9 1/8"	48"	11 1/2"	24 3/4"	4 3/8"	4"	17"	5 5/8"	16"	16"	57 1/4"	28 1/2"	92 1/4"	59 1/4"

NAME:	DATE (MM/DD/YYYY):	TITLE:
DRAWN BY: AD	07/23/2021	VARIPAK WITH ENERGY RECOVERY WHEEL SIZE 1 (OUTDOOR) HORIZONTAL INTAKE & SUPPLY HORIZONTAL EXHAUST IN HORIZONTAL EXHAUST DISCHARGE
CHECKED BY: BOB/FS	07/23/2021	UNIT NO. VPWR1XX
		SCALE: NTS
<small>THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CGC GROUP. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CGC GROUP IS PROHIBITED.</small>		SHEET 1 OF 1